


TYPICAL VERTICAL SECTION SHOWING THE USE OF SILVERFLAME FIRE PILLOWS WITHIN CABLE TRUNKING SYSTEM



ADDITIONAL FRAMING MAY BE REQUIRED TO SUPPORT THE BATT SYSTEM IF THE CLEAR VOID EXCEEDS 0.72m², PLEASE REFER TO FIRESTOPIT FIRE STOPPING INSTALLATION MANUAL FOR DETAILS

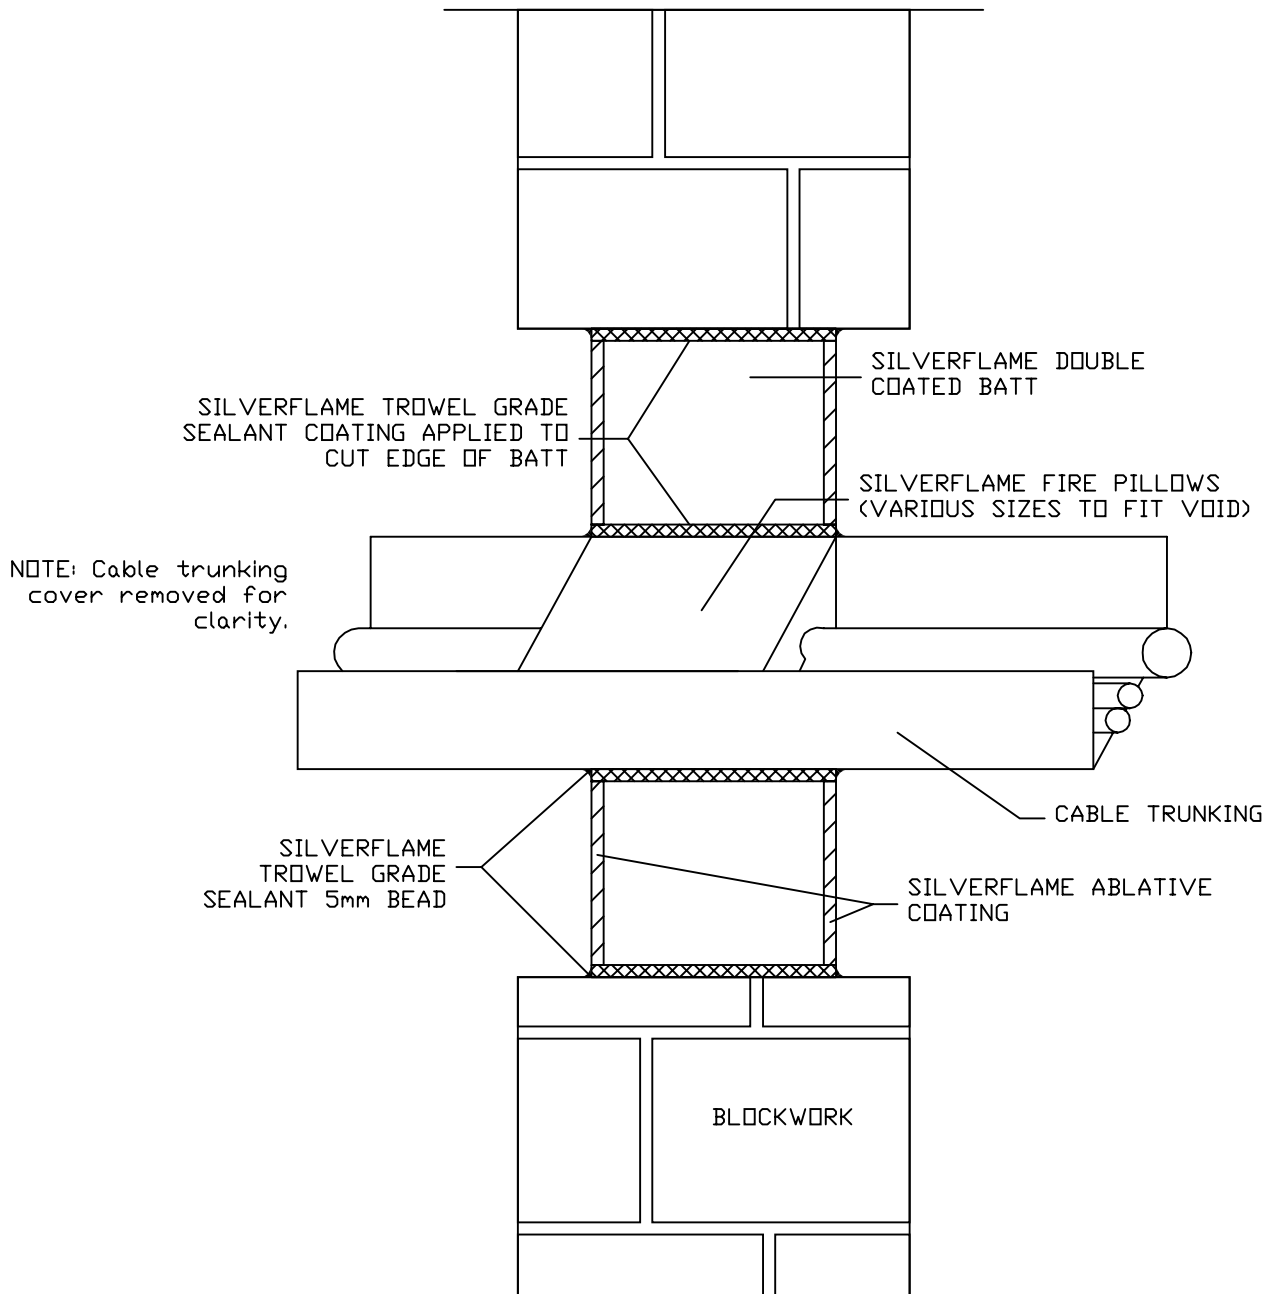

Firestopit.com
Swadlincote Road
Woodville
Swadlincote
DE11 8DD, UK.
TEL: 01283 229022
FAX: 01283 222219

FILE NAME:

DET01

DATE:

30/04/02

THESE DESIGN DETAILS REMAIN THE PROPERTY OF FIRESTOPIT.COM AND SHOULD NOT BE USED IN CONJUNCTION WITH ANY OTHER MANUFACTURERS PRODUCTS OR SPECIFICATIONS. DOING SO MAY RESULT IN THE FAILURE OF THE FIRE STOPPING SYSTEM AND WILL RENDER ANY PRODUCT OR SYSTEM GUARANTEES NULL & VOID